




KETERANGAN :	
	ADRESSEBLE PHOTOELECTRIC SMOKE DETECTOR
	ADRESSEBLE RATE OF RISE HEAT DETECTOR
	ADRESSEBLE RATE OF RISE HEAT DETECTOR
	ADRESSEBLE RATE OF RISE HEAT DETECTOR
	ADRESSEBLE RATE OF RISE HEAT DETECTOR
	ADRESSEBLE RATE OF RISE HEAT DETECTOR
	MANUAL PUSH BUTTON
	ALARM BELL
	FLASHER LAMP
	INTERCOM SET
	FLOW SWITCH
	TAMPER SWITCH
JBFA JUNCTION BOX FIRE ALARM	
MCPFA MAIN CONTROL PANEL FIRE ALARM	
	MONITOR MODULE
	MINI MONITOR MODULE
	TERMINAL MODULE
	CONTROL MODULE
	ISOLATOR MODULE

DETAIL JBFA

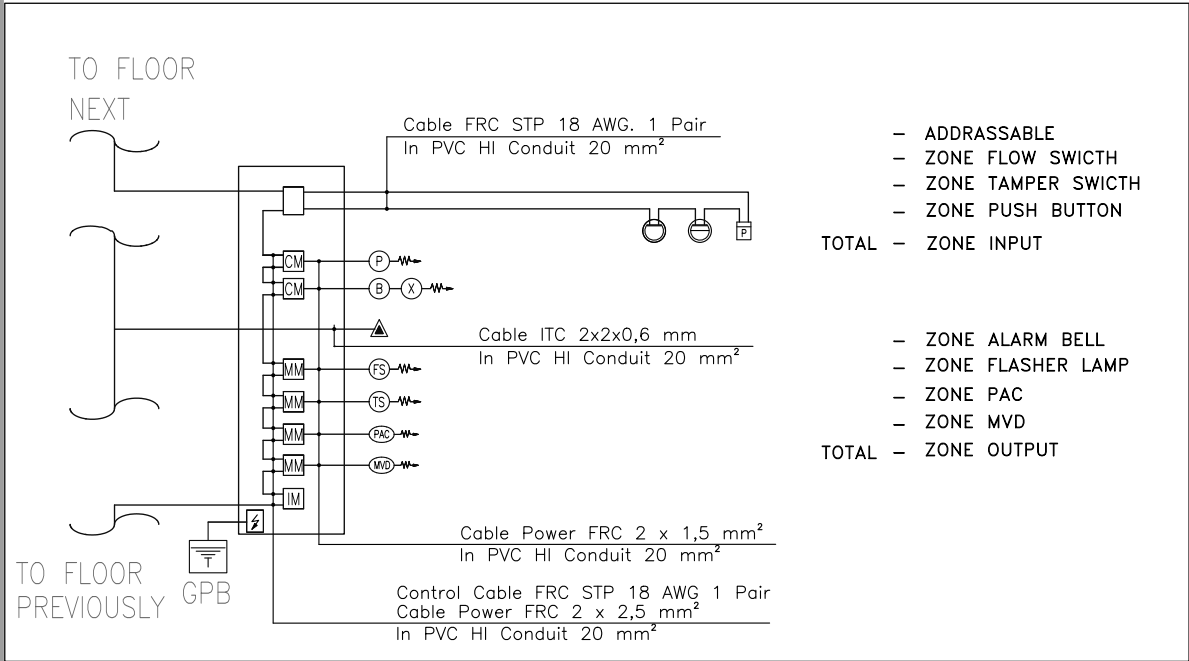

DAFTAR PERALATAN FIRE ALARM

NO	LANTAI	ZONE INPUT	ZONE OUTPUT											KETERANGAN
01	LANTAI GF	10	3	7	—	8	—	1	1	1	1	1	1	
02	LANTAI 1	11	3	6	2	9	—	1	1	1	1	1	1	
03	LANTAI 2	19	3	16	—	15	1	1	1	1	1	1	1	
04	LANTAI 3	20	3	16	1	11	—	1	1	1	1	1	1	
05	LANTAI 3A	14	3	9	2	6	—	1	1	1	1	1	1	
06	LANTAI ROOF TOP			—	—	—	—	—	—	—	—	—	—	
	TOTAL	74	15	54	5	49	1	5	5	5	5	5	5	

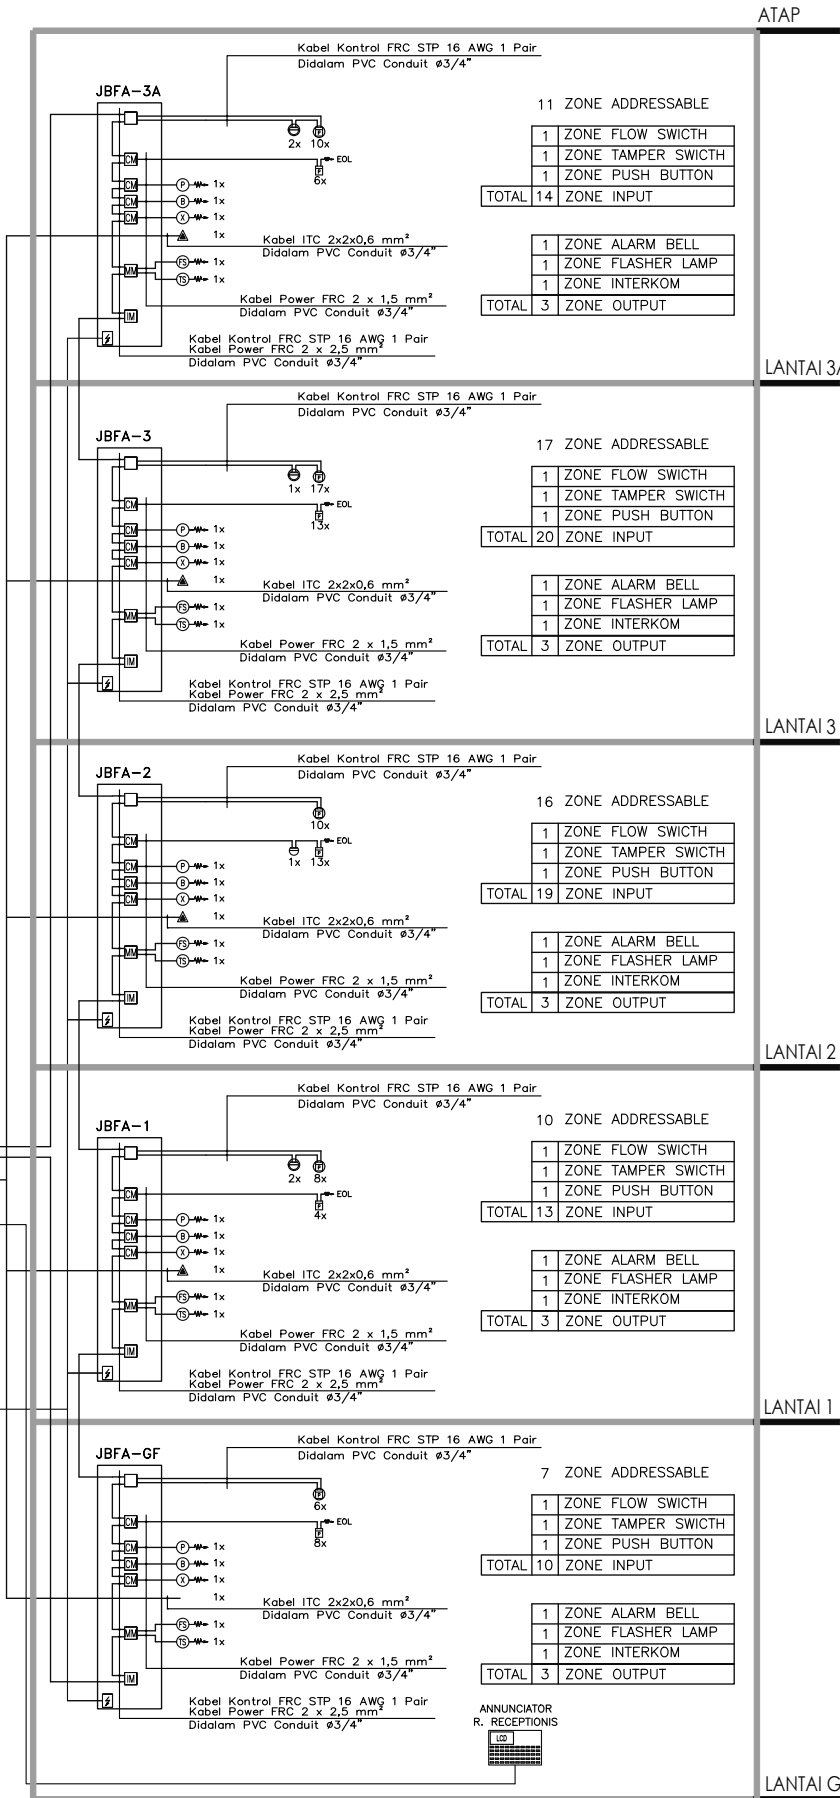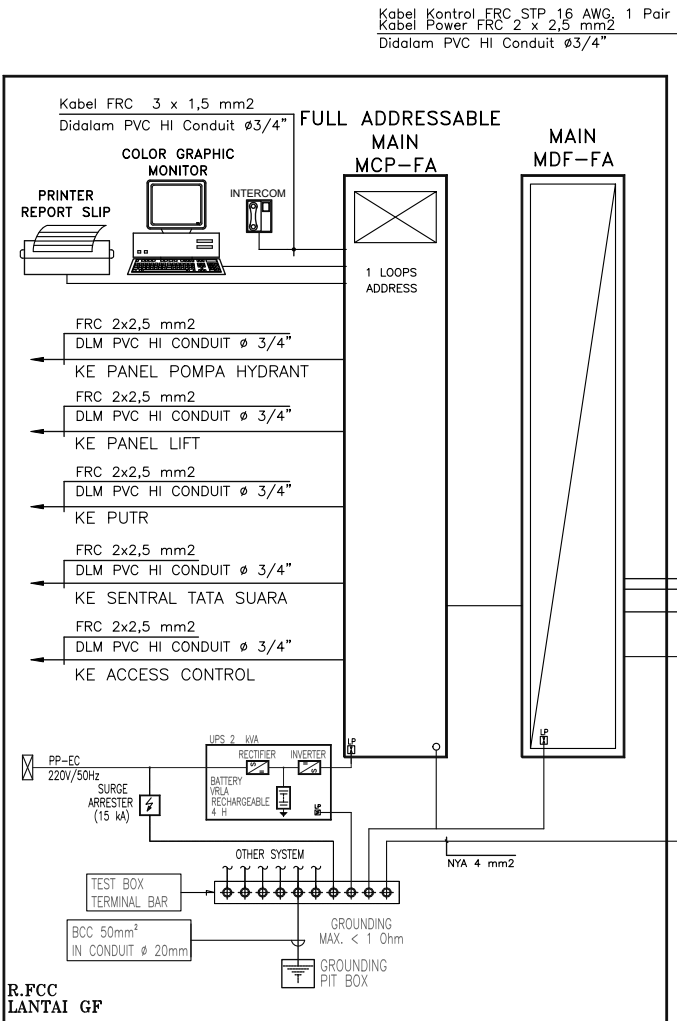

OWNER/CLIENT  APPROVED : .../.../... (signed)	PROJECT BPDP KELAPA SAWIT Jl.Medan Merdeka Tim, RT.7/RW.1, Gambir, Kec. Gambir, Kota Jakarta Pusat, Daerah Khusus Ibukota Jakarta 10110	INTERIOR DESIGN CONSULTANT PT. MADEA AGKASAMA Jl. Hati Suci No. 4 Gd. Sakura Lt. 2 Room 201 Kel. Kampung Bali, Kec. Tanah Abang, Jakarta Pusat Telp. 021-2303483, Fax. 021-2303483 APPROVED : //	MEP CONSULTANT  PT. DUTA PRATAMA ENGINEERING MECHANICAL & ELECTRICAL ENGINEER Rukan Taman Murya Blok M No. 37, J. Batu Mulia No. 1 Murya Utara Kembangan - Jakarta Barat 11620 Phone : 021-5845046, 5845047, 5845056, Fax : 021-58474531 Email : dpeptline@gmail.com, pt.dpeptline@yahoo.com	DRAWING TITLE DIAGRAM SISTEM FIRE ALARM SCALE : NTS ALL MEASUREMENT MUST BE CHECKED AT BY SITE BY THE CONTRACTORS AND ANY DIFFERENCES REPORTED/INITIATED TO THE DESIGNER FOR CLARIFICATION BEFORE PROCEEDING.	REVISION : #	DRAWN Denny DATE : 15/05/24 CHECKED Widodo DATE : 15/05/24 DRAWING FOR TENDER	DRAWING NUMBER EC-101 PAGE DATE : 2024/05/10
--	--	---	---	--	-----------------	--	---