

NOTE :
- INSTALASI PEMADAM LIHAT JUGA GAMBAR
DIAGRAM SISTEM


KETERANGAN :

a (HURUF) – NAMA PIPA TEGAK
b (ANGKA) – NOMOR PIPA TEGAK
c – NOMINAL DIAMETER

- IBB = INDOOR HIDRAN BOX
PFE = PORTABLE FIRE EXTINGUISHER
CAP, 5 KG, CO2
PFE = PORTABLE FIRE EXTINGUISHER
CAP, 3 KG, DRY POWDER TYPE
TIF = TROLI FIRE EXTINGUISHER
CAP, 25 KG, CO2
X = KEPALA SPRINKLER (PENDENT TYPE)
BCV = BRANCH CONTROL VALVE
MCV = MAIN CONTROL VALVE
TDV = TEST DRAIN VALVE
SP = PIPA SPRINKLER
SPDR = PIPA TEGAK DRAIN SPRINKLER

SPR	SPDR
Ø150	Ø80
FH	SPDR
Ø150	Ø80

PIPE SCHEDULES		
No.	ND (mm)	QUANTITY (PCS)
1	25	2 SPRINKLER
2	32	3 SPRINKLER
3	40	5 SPRINKLER
4	50	10 SPRINKLER
5	65	20 SPRINKLER
6	80	40 SPRINKLER
7	100	100 SPRINKLER

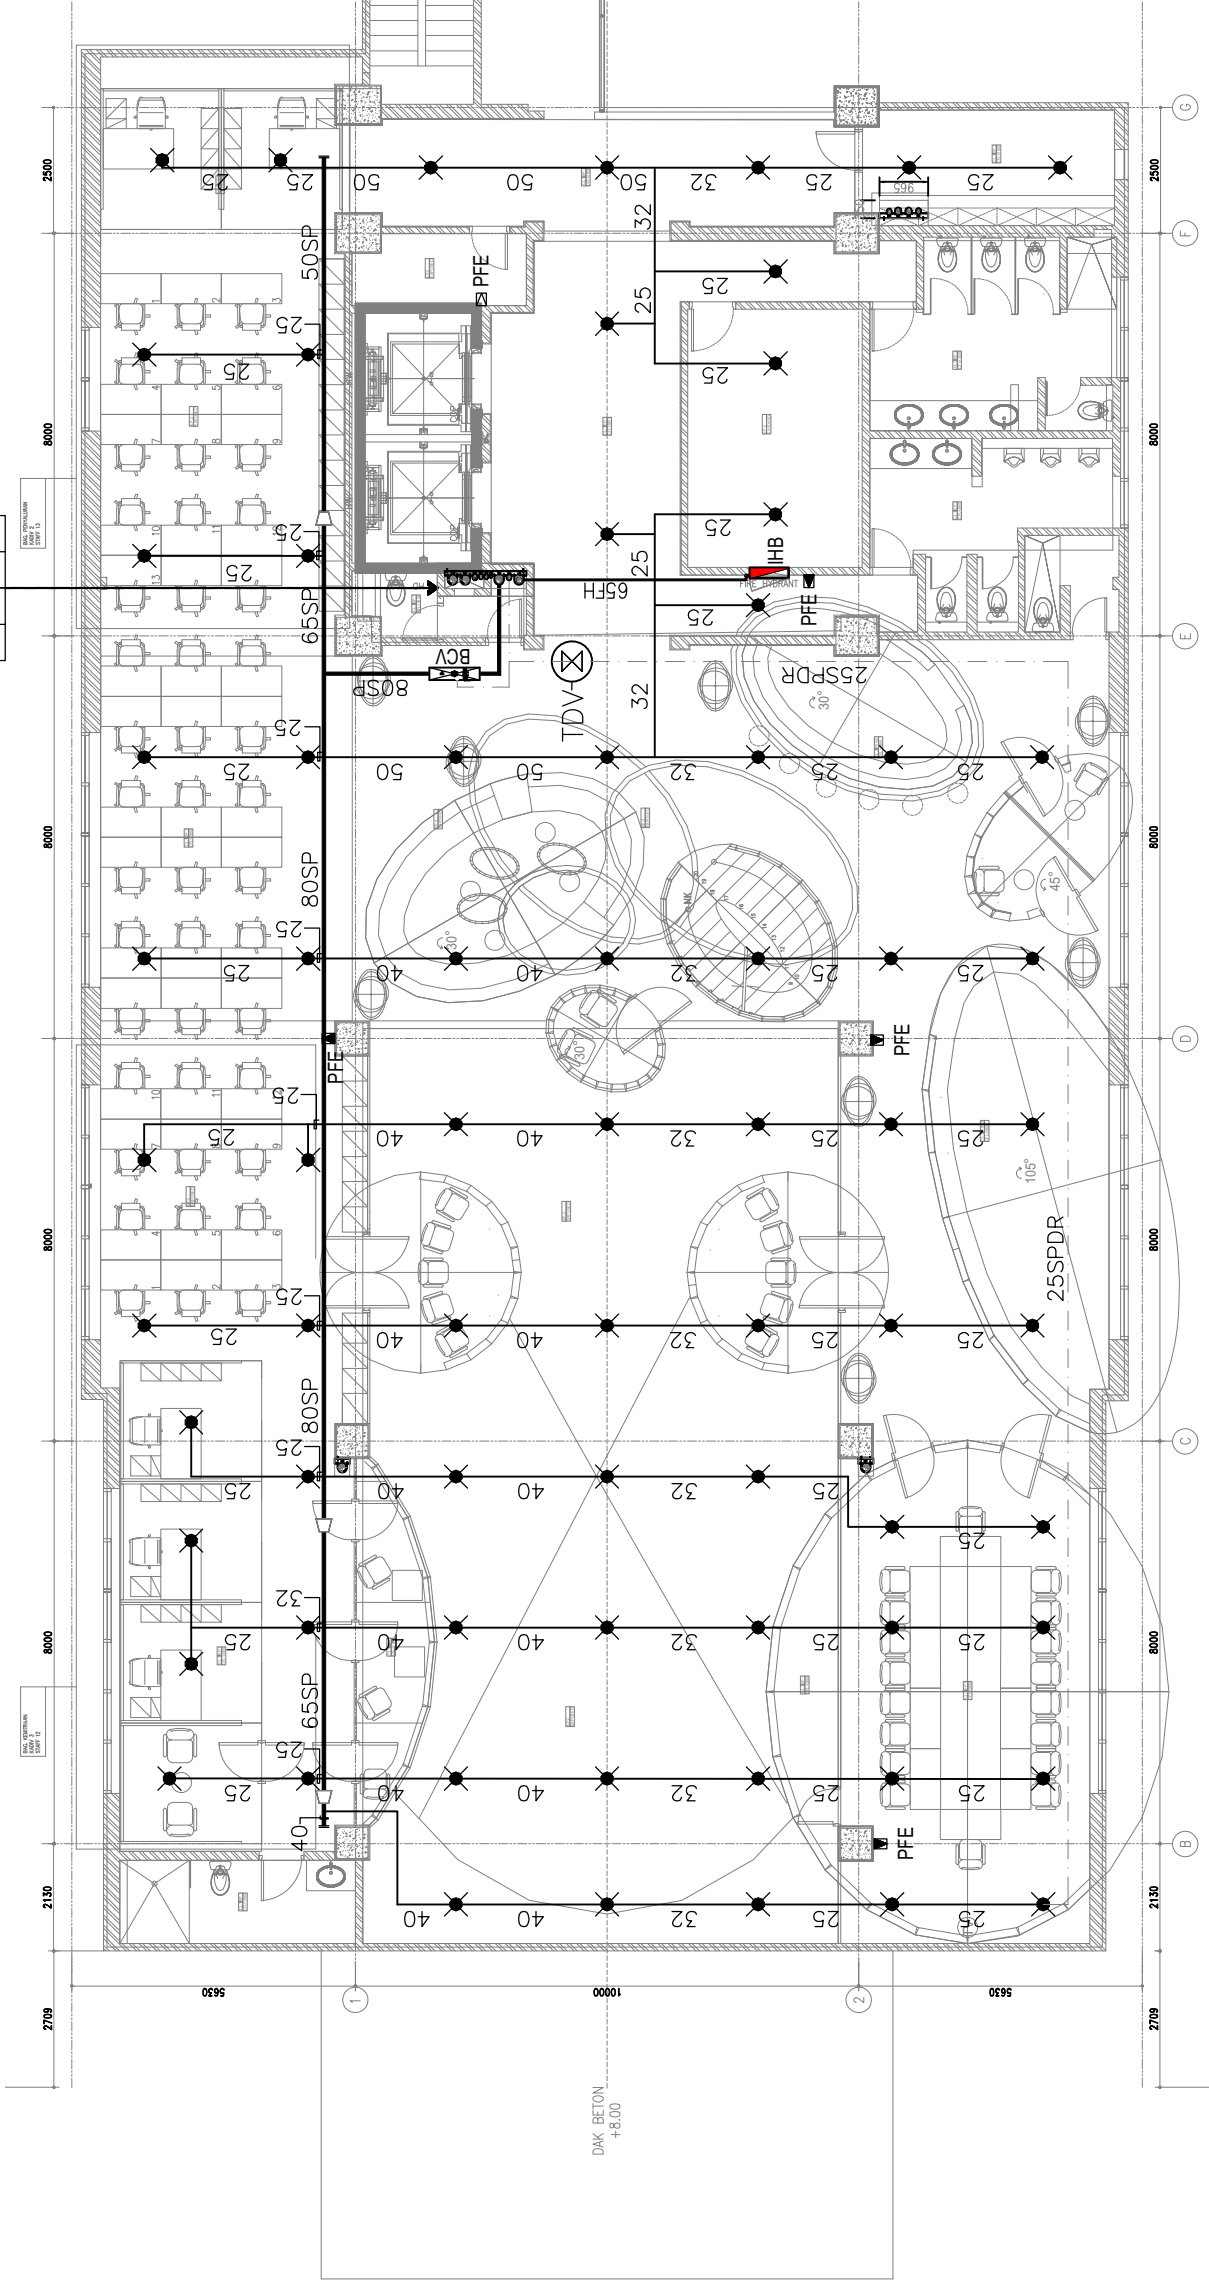

BPDP
KELAPA SAWIT

Jl. Medan Merdeka Tim, RT.7/RW.1, Gambir,
Kec. Gambir, Kota Jakarta Pusat, Daerah
Khusus Ibukota Jakarta 10110

APPROVED : .../.../...

(signed)
..... (name)
..... (position)
..... (Dep./Div.)

INTERIOR DESIGN CONSULTANT

PT. **M** ADEA AGKASAMA
Jl. Heli Suci No. 4 Gd. Sakura Lt. 2 Room 201
Kel. Kampung Bali, Kec. Tanah Abang, Jakarta Pusat
Telp. 021 - 2303483, Fax. 021 - 2303483
APPROVED : //

MEP CONSULTANT



PT. **DUTA PRATAMA ENGINEERING**

MECHANICAL & ELECTRICAL ENGINEER
Ruang Kerja: Menoreh Blok A, Lantai 20, J. Raya Muli No. 1
Kec. Kuning, Kota Cirebon, Jawa Barat 47132
Telp. 031 - 5847431
Email : dputa-mep@gmail.com, dputa-mep@indosat.net.id

DRAWING TITLE

DENAH INSTALASI
PEMADAM KEBAKARAN LANTAI - 2

SCALE : 1 : 150

ALL MEASUREMENT MUST BE CHECKED AT BY SITE
BY THE CONTRACTORS AND ANY DIFFERENCES
REPORTED/INTAIED TO THE DESIGNER FOR
CONFIRMATION BEFORE PROCEEDING.

DRAWN

Maman

DATE : 15/05/24

CHECKED

Sopyan

DATE : 15/05/24

DRAWING FOR

REVISION : R-1

(signed)

..... (name)
..... (position)
..... (Dep./Div.)

TENDER

DATE : 2024/05/10

PROJECT

MEP CONSULTANT

DRAWING TITLE

DRAWING NUMBER

PK-203