



NOTE :
— INSTALASI PEMADAM LIHAT JUGA GAMBAR
DIAGRAM SISTEM

KETERANGAN :		
a	b	c
a (HURUF) – NAMA PIPA TEGAK		
b (ANGKA) – NOMOR PIPA TEGAK		
c – NOMINAL DIAMETER		
IHB	= INDOOR HIDRAN BOX	
☐	= PORTABLE FIRE EXTINGUISHER	
PFE	CAP, 5 KG, CO2	
▲	= PORTABLE FIRE EXTINGUISHER	
PFE	CAP, 3 KG, DRY POWDER TYPE	
▲	= TROLI FIRE EXTINGUISHER	
TFE	CAP, 25 KG, CO2	
✕	= KEPALA SPRINKLER (PENDENT TYPE)	
BCV	= BRANCH CONTROL VALVE	
MCV	= MAIN CONTROL VALVE	
TDV	= TEST DRAIN VALVE	
SP	= PIPA SPRINKLER	
SPDR	= PIPA TEGAK DRAIN SPRINKLER	

PIPE SCHEDULES	
No.	ND (mm)
1	25
2	32
3	40
4	50
5	65
6	80
7	100
QUANTITY (PCS)	
1	2 SPRINKLER
2	3 SPRINKLER
3	5 SPRINKLER
4	10 SPRINKLER
5	20 SPRINKLER
6	40 SPRINKLER
7	100 SPRINKLER

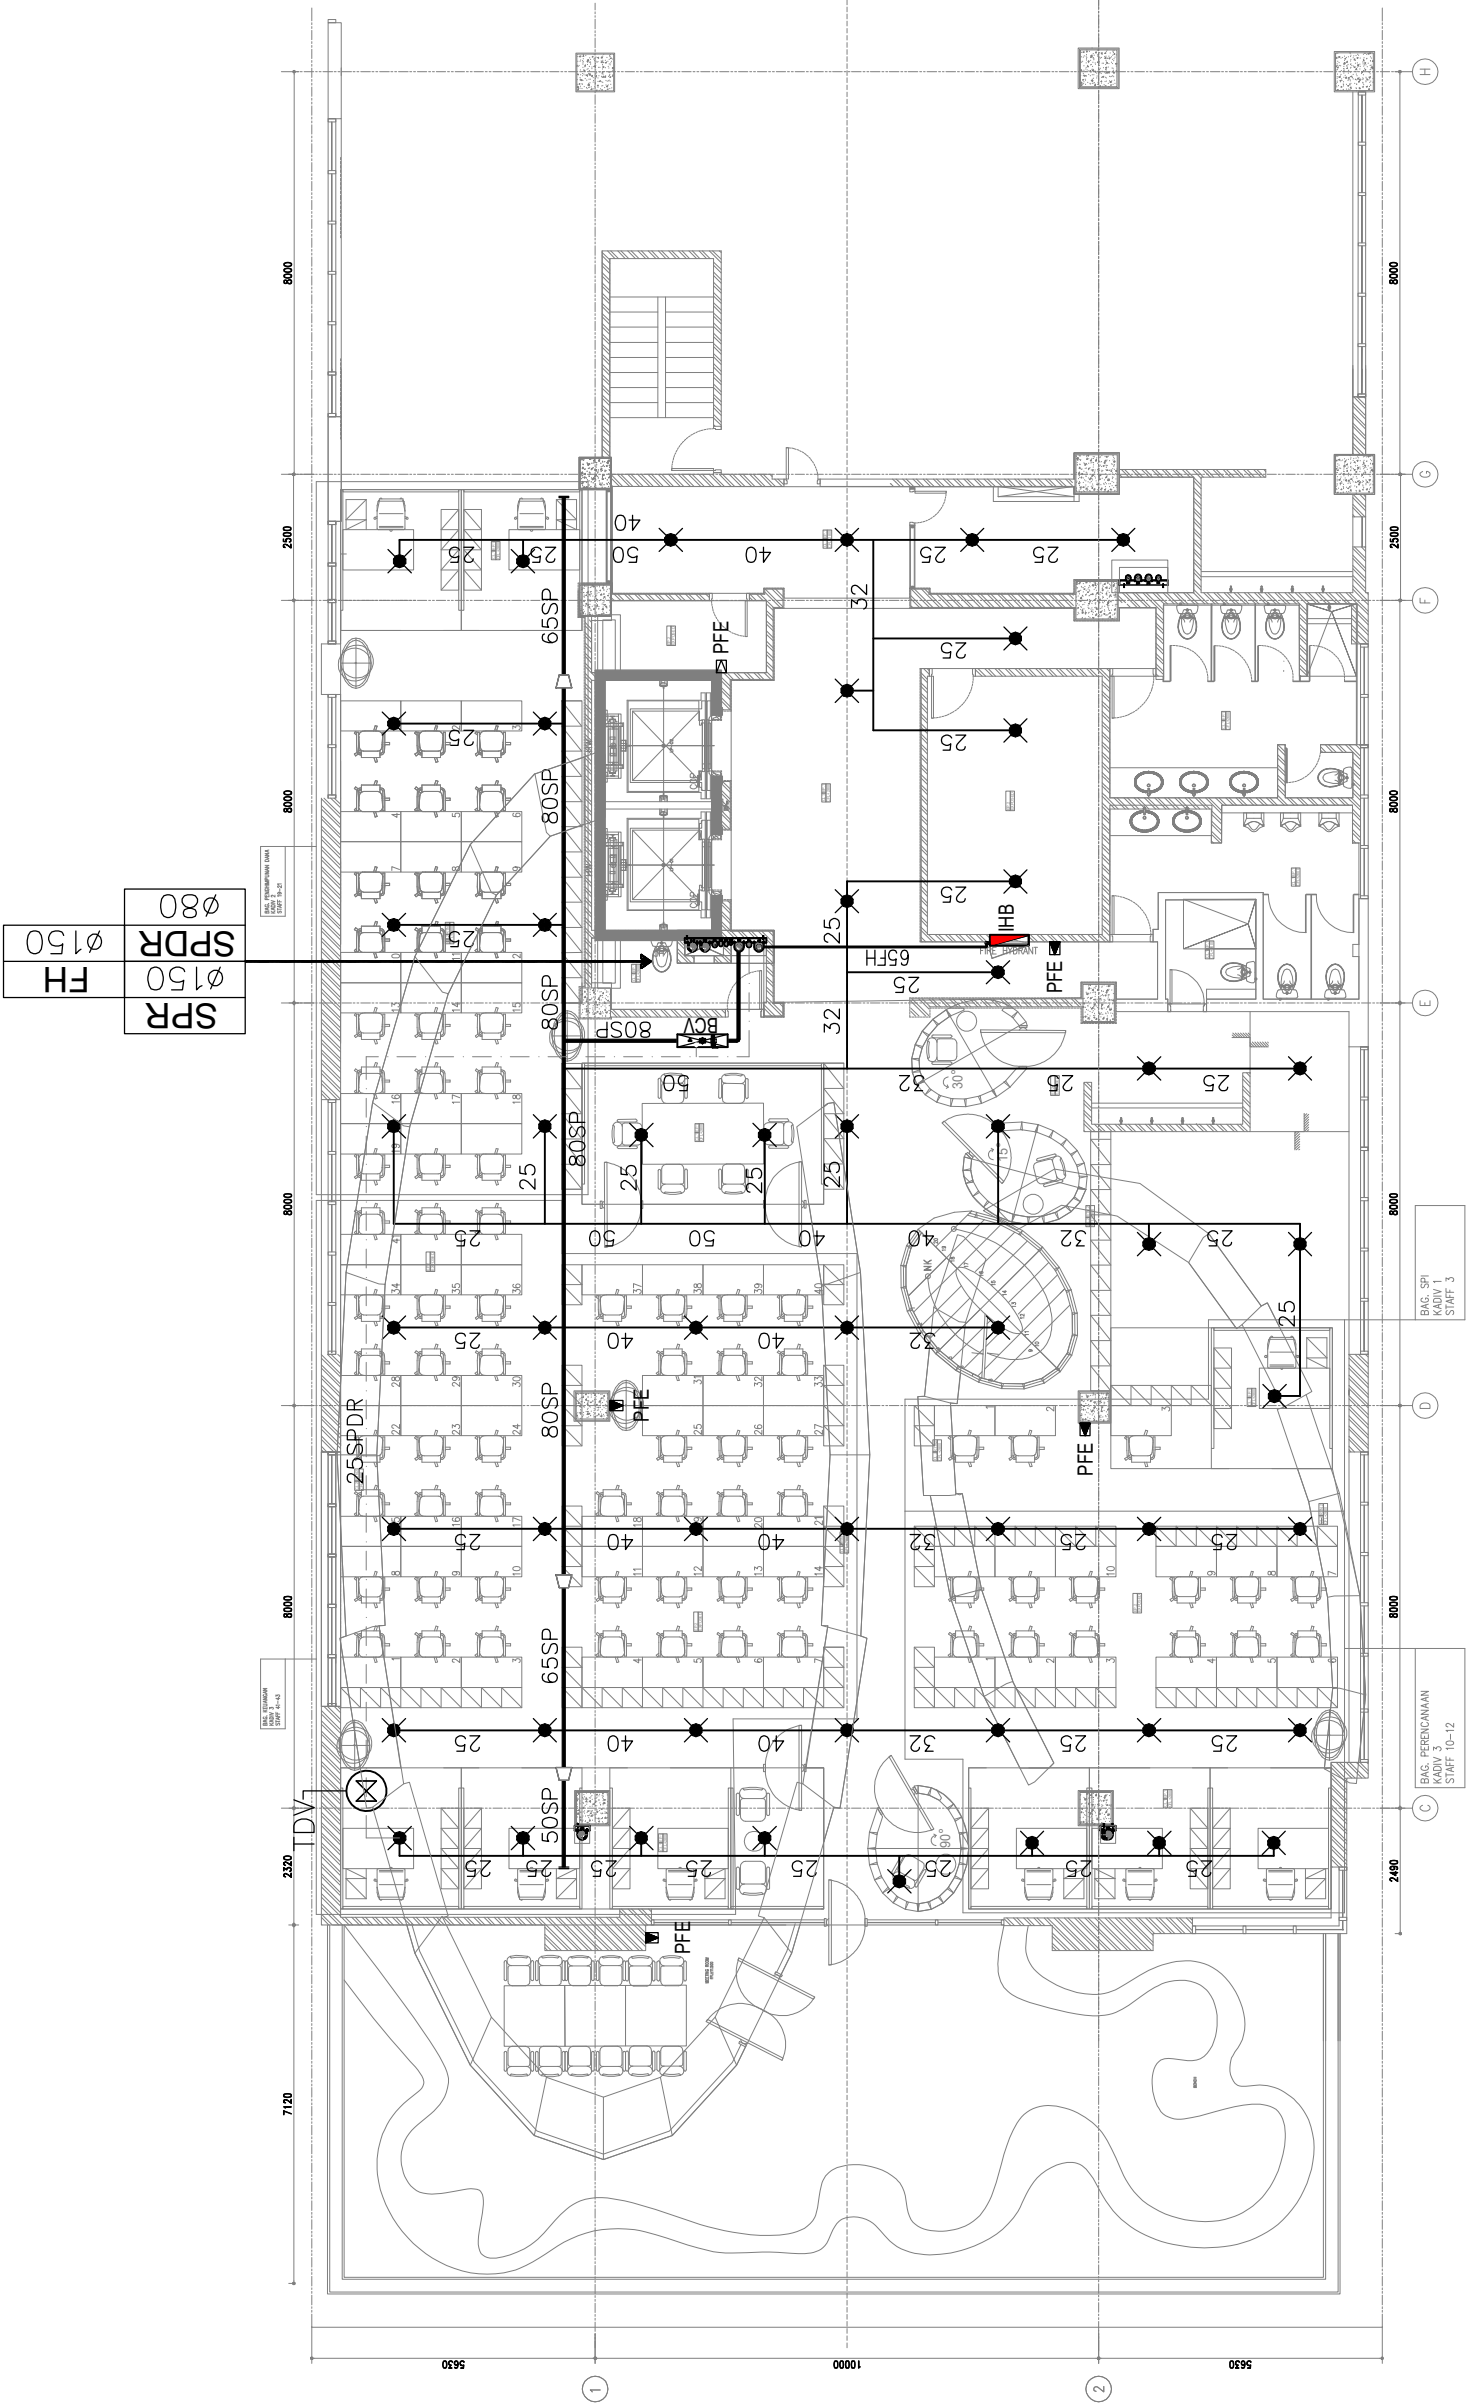

 OWNER/CLIENT APPROVED : .../.../... (name) (position) (Dep./Dk.) (signed)	PROJECT BDP KELAPA SAWIT Jl. Medan Merdeka Tim, RT.7/RW.1, Gambir, Kec. Gambir, Kota Jakarta Pusat, Daerah Khusus Ibukota Jakarta 10110	INTERIOR DESIGN CONSULTANT PT. M ADEA AGKASAMA Jl. Heli Suci No. 4 Gd. Sakura Lt. 2 Room 201 Kel. Kampung Bali, Kec. Tanah Abang, Jakarta Pusat Telp. 021 - 2303483, Fax. 021 - 2303483 APPROVED : //	MEP CONSULTANT PT. DUTA PRATAMA ENGINEERING MECHANICAL & ELECTRICAL ENGINEER Ruang Tembok Merpati Blok A No. 25, Jl. Raya Muli No. 1 Kec. Kuning, Kota Jakarta Barat, Daerah Khusus Ibukota Jakarta 10150 Telp. 021 - 5847431, Fax. 021 - 5847431 Email : dputa-mep@gmail.com, dputa-mep@indosat.net.id	DRAWING TITLE DENAH INSTALASI PEMADAM KEBAKARAN LANTAI - 3	DRAWING NUMBER PK-204	DRAWN Maman	DRAWING FOR TENDER
						CHECKED Sopyan	
						DATE : 15/05/24	
						DATE : 2024/05/10	