


. INSTALASI PLAMBITING LIHAT JUGA GAMBAR  
DIAGRAM SISTEM


a - b	a (HURUF) – NAMA PIPA TEGAK
c	b (ANGKA) – NOMOR PIPA TEGAK
	c – NOMINAL DIAMETER

CW	: CLEAN WATER
CW/B	: CLEAN WATER BOOSTER
CW/G	: CLEAN WATER GRAVITASI
CW/T	: CLEAN WATER TRANSFER
RW	: RAIN WATER
SW	: SEWAGE WATER
WW	: WASTE WATER
XD	: KITCHEN DRAIN
VT	: VENTING
RD	: ROOF DRAIN
PD	: PLANTER DRAIN
GV	: GATE VALVE
SRH	: SUMUR RESAPAN AIR HUMAN

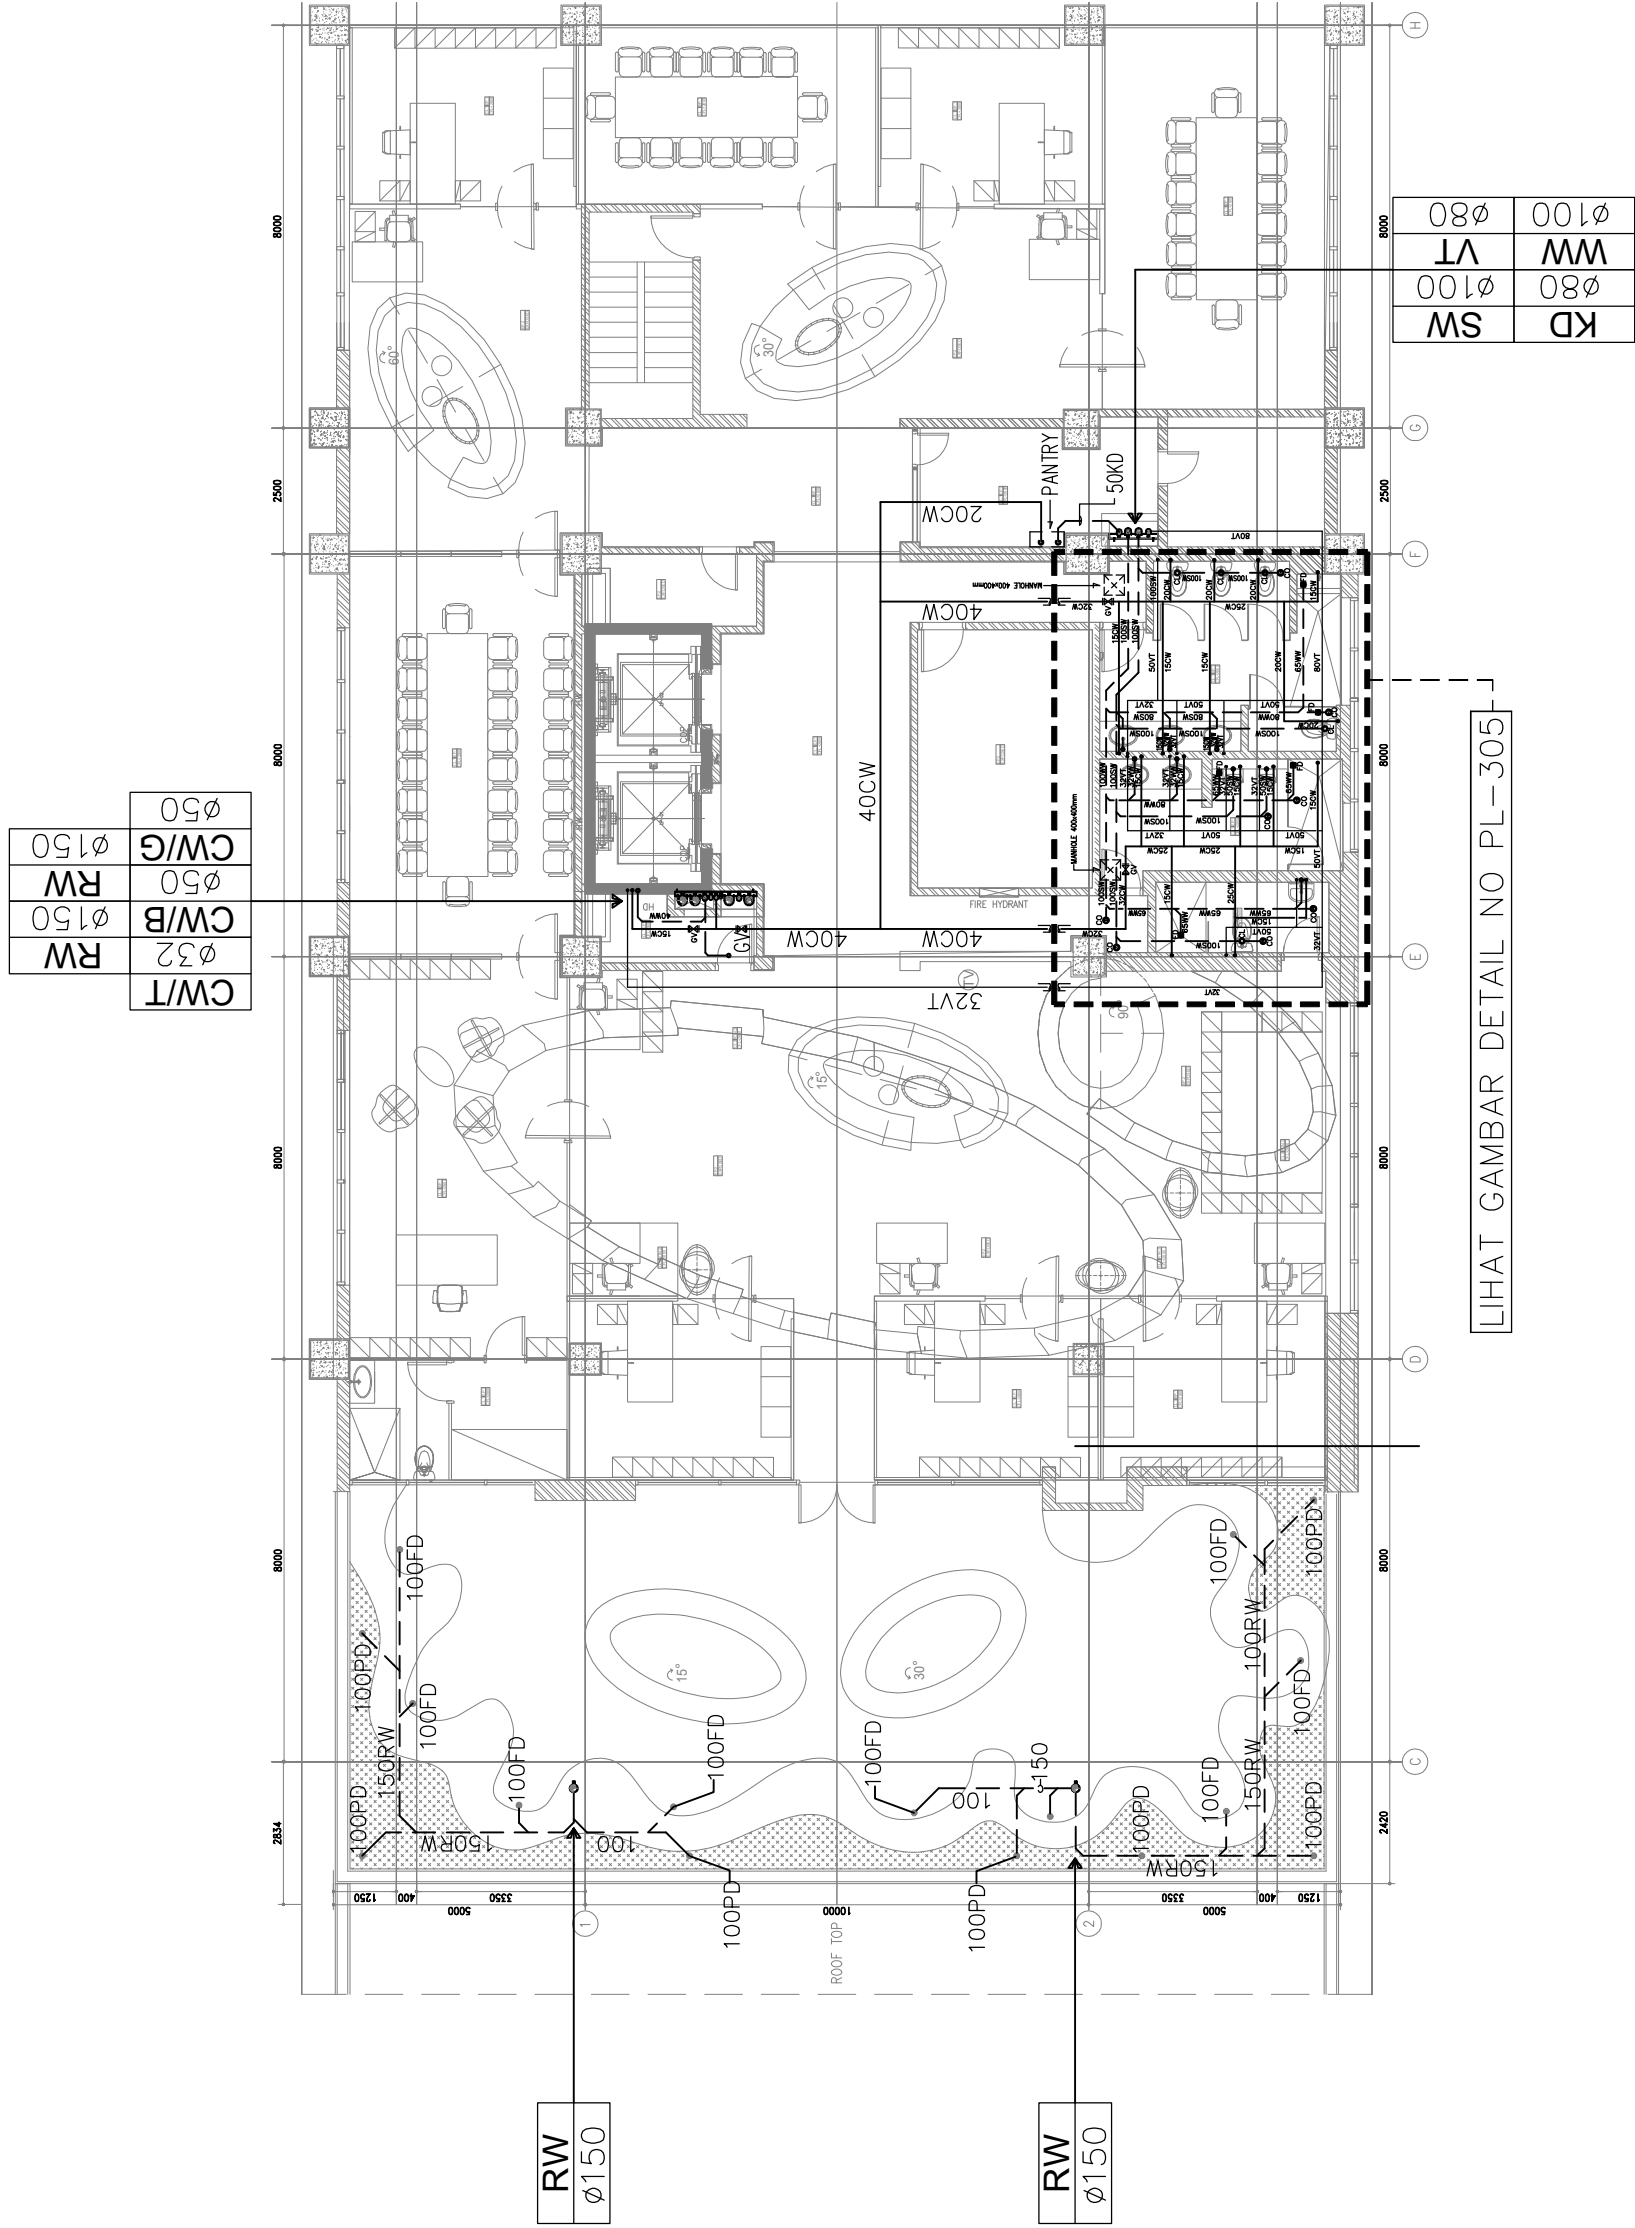

LIHAT GAMBAR DETAIL NO PL-305

OWNER/CLIENT

 **sawit**

APPROVED : ..../.. /...

(signed) .....

(name) .....

(position) .....

(Dep./Div.) .....

BPD  
KELAPA SAWIT

(signed)

PT. **M**ADEA  
AGKASAMA

APPROVED : //

PT. DUTA PRATAMA ENGINEERING

Rukan Taman Meruya Blok M No. 37, J. Batu Mulia No. 1  
Meruya Utara Kebonjangan – Jakarta Barat 11620  
Phone : 021-5845546, 5845547, 5845556, Fax : 021-58474531  
Email : doest.me@gmail.com, ptidpe.me@yahoo.com

DENAH INSTALASI PLAMBING  
LANTAI - 3A

ALL MEASUREMENT MUST BE CHECKED AT BY SITE BY THE CONTRACTORS AND ANY DIFFERENCES REPORTED/INITIATED TO THE DESIGNER FOR CLARIFICATION BEFORE PROCEEDING.

Maman

PL-205

DATE : 15/05/24

DRAWING FOR

TENDER

DATE : 2024/05/10