


A.


PU.101/A&B (POMPA BOOSTER)
POMPA DISTRIBUSI (PACKAGE) INCLUED RUMAH POMPA
VARIABLE SPEED CONSTANT PRESSURE
TYPE : DISTRIBUTION PUMP-CENTRIFUGAL END SUCTION
KAP. 2 x 110 LPM; 1.5 BAR
OPERASI : 2 PARALLEL ALTERNATE
DAYA : 2 x 0,65 KW

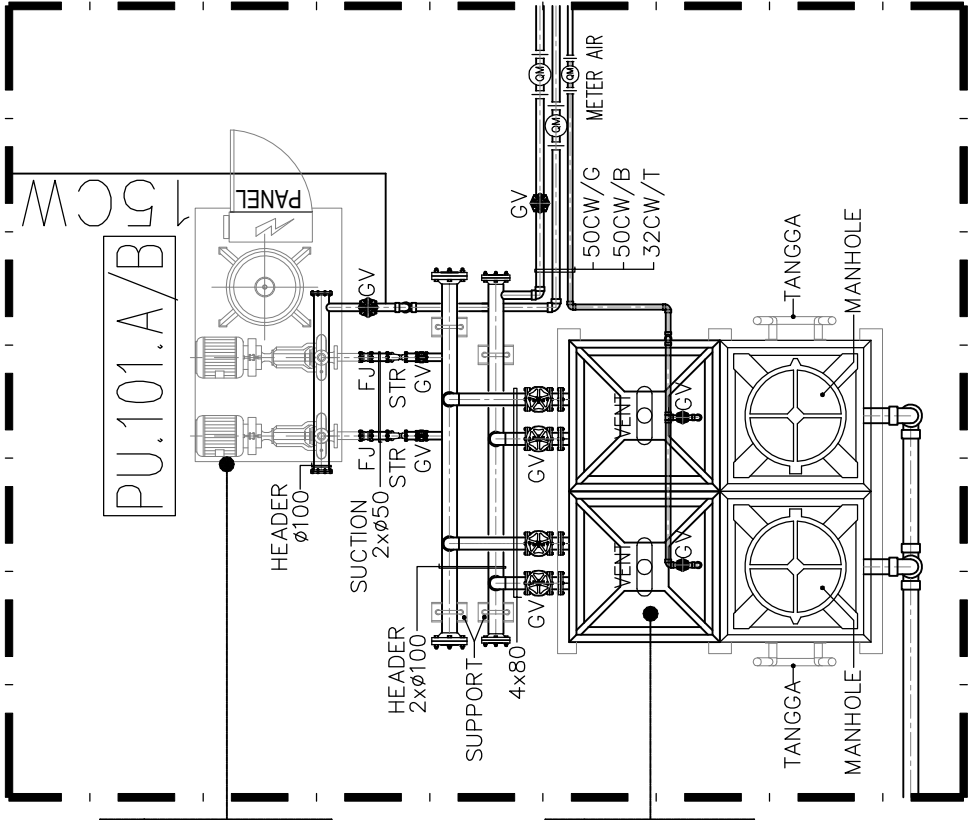

TN.101.A/TN.101 (ROOF WATER TANK)
KAP : 5m3
TYPE : FRP - PANEL
DIM : 2x2x2m
LEVEL AIR : 1.6m (efektif)
BERAT : 7 TON


DETAIL TANGKI

SKALA 1:50

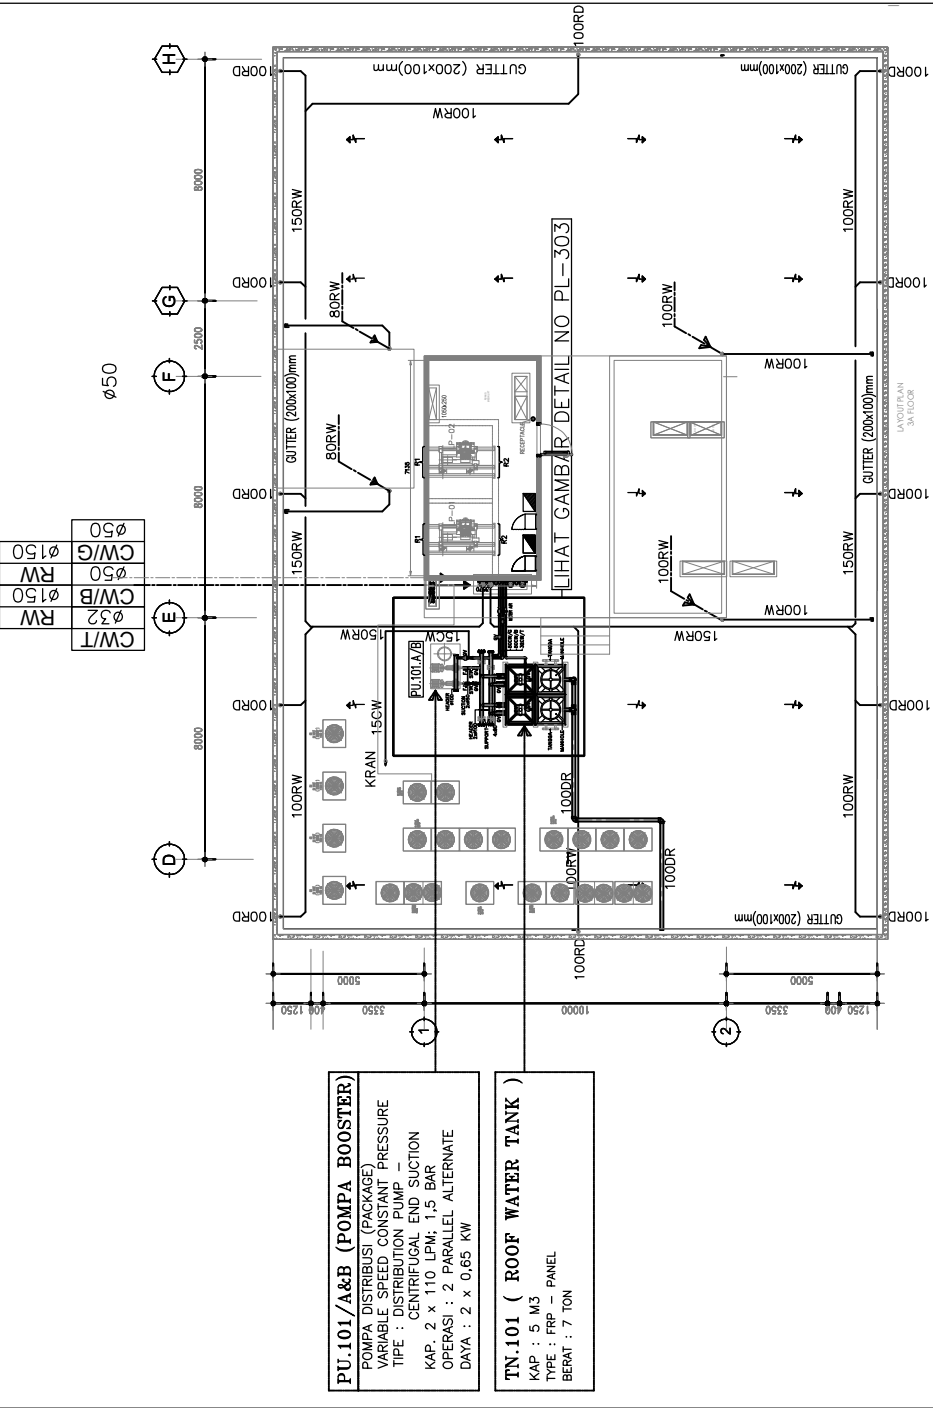

PU.101/A&B (POMPA BOOSTER)
POMPA DISTRIBUSI (PACKAGE)
VARIABLE SPEED CONSTANT PRESSURE
TYPE : DISTRIBUTION PUMP -
CENTRIFUGAL END SUCTION
KAP. 2 x 110 LPM; 1.5 BAR
OPERASI : 2 PARALLEL ALTERNATE
DAYA : 2 x 0,65 KW

TN.101 (ROOF WATER TANK)
KAP : 5 M3
TYPE : FRP - PANEL
BERAT : 7 TON

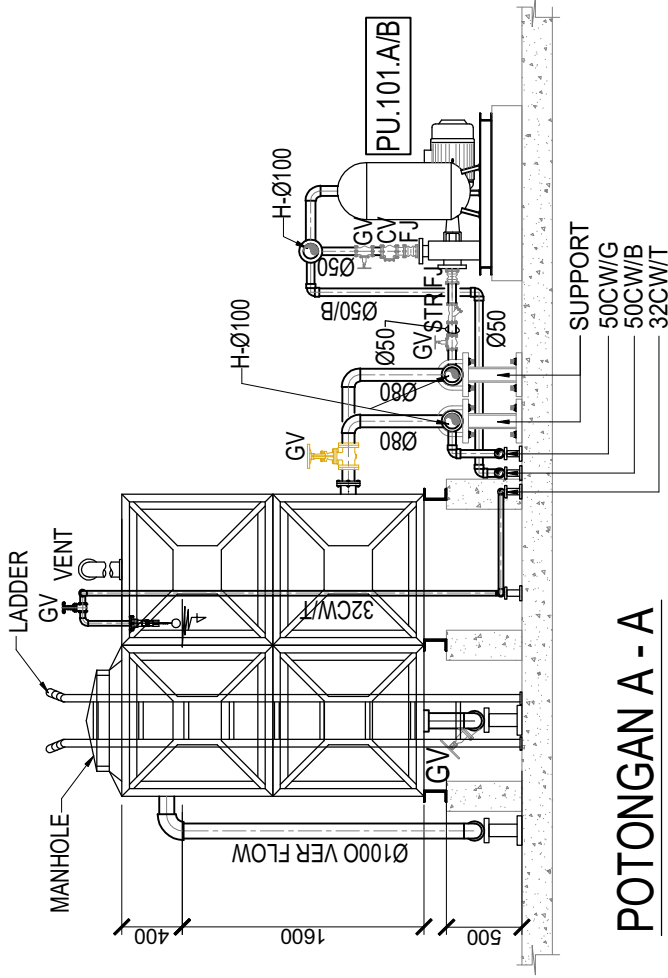

POTONGAN A - A

SKALA 1:50



OWNER/CLIENT

PROJECT
BDP
KELAPA SAWIT

Jl. Medan Merdeka Tim, RT.7/RW.1, Gambir,
Kec. Gambir, Kota Jakarta Pusat, Daerah
Khusus Ibukota Jakarta 10110

APPROVED : .../.../...

(name)
(position)
(Dep./Div.)

INTERIOR DESIGN CONSULTANT

PT. M ADEA AGKASAMA
Jl. Heli Suci No. 4 Gd. Sakura Lt. 2 Room 201
Kel. Kampung Bali, Kec. Tanah Abang, Jakarta Pusat
Telp. 021 - 2303483 , Fax. 021 - 2303483
APPROVED : //

MEP CONSULTANT



PT. DUTA PRATAMA ENGINEERING
MECHANICAL & ELECTRICAL ENGINEER
Kedua Tembok Merpati Blok A No. 20, A. Bina Muli No. 1
Merpati Utara, Merpati Blok A No. 20, A. Bina Muli No. 1
Email : dpe@mepeind.com, info@mepeind.com

DRAWING TITLE

DETAIL DAN POTONGAN POMPA
TANGKI ATAP

SCALE : 1 : 50

ALL MEASUREMENT MUST BE CHECKED AT BY SITE
BY THE CONTRACTORS AND ANY DIFFERENCES
REPORTED/INTAIED TO THE DESIGNER FOR
CONFIRMATION BEFORE PROCEEDING.

REVISION : R-1

DATE

DRAWN

Maman

PAGE

CHECKED

Sopyan

DATE : 15/05/24

DATE : 15/05/24

DRAWING FOR

TENDER

DRAWING NUMBER

PL-303