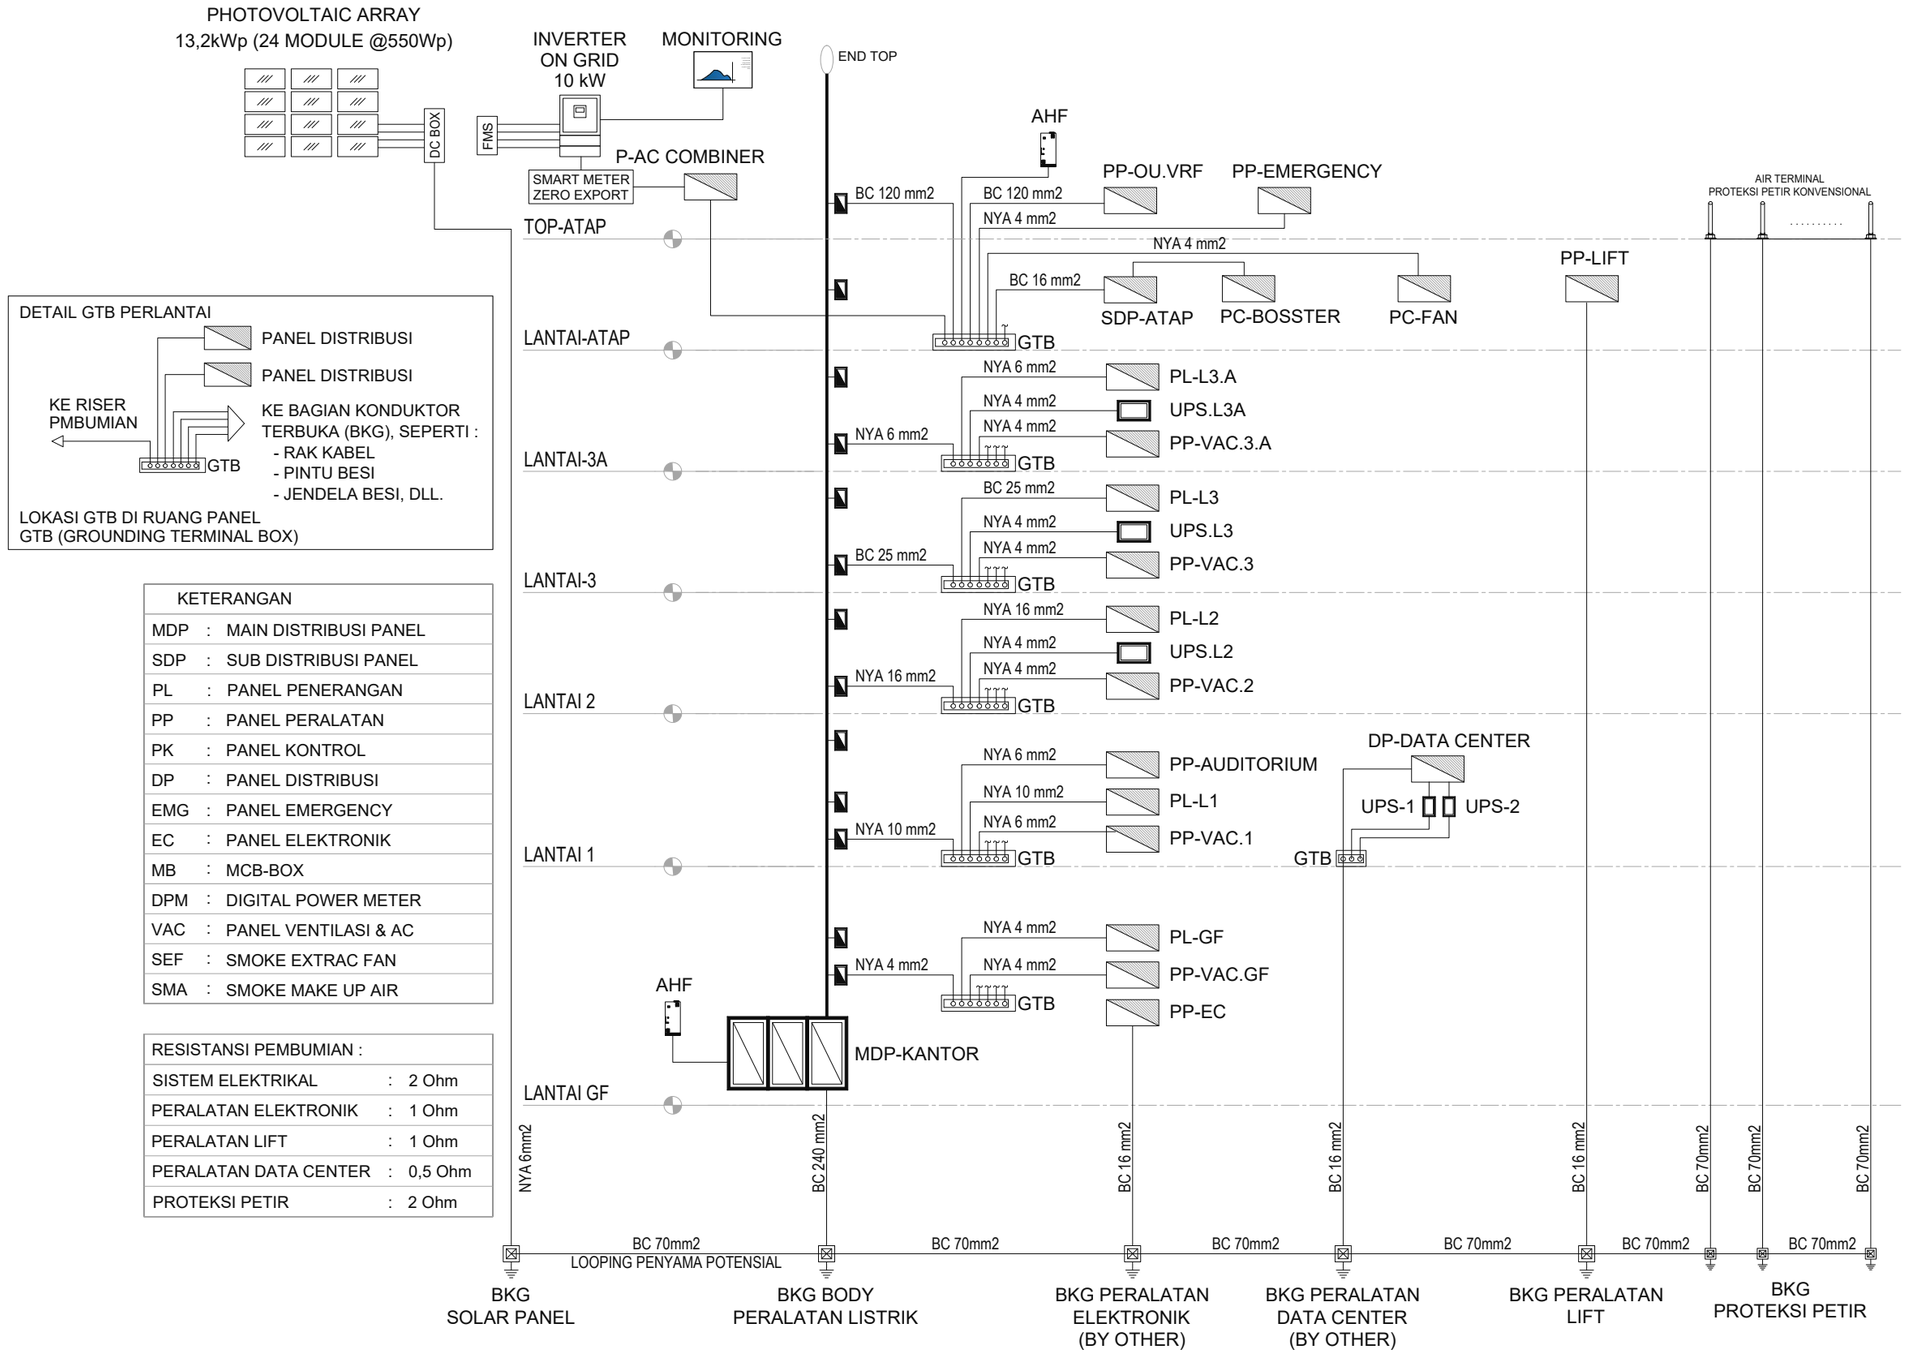

DETAIL GTB PERLANTAI

LOKASI GTB DI RUANG PANEL
GTB (GROUNDING TERMINAL BOX)

KETERANGAN		
MDP	:	MAIN DISTRIBUSI PANEL
SDP	:	SUB DISTRIBUSI PANEL
PL	:	PANEL PENERANGAN
PP	:	PANEL PERALATAN
PK	:	PANEL KONTROL
DP	:	PANEL DISTRIBUSI
EMG	:	PANEL EMERGENCY
EC	:	PANEL ELEKTRONIK
MB	:	MCB-BOX
DPM	:	DIGITAL POWER METER
VAC	:	PANEL VENTILASI & AC
SEF	:	SMOKE EXTRAC FAN
SMA	:	SMOKE MAKE UP AIR

RESISTANSI PEMBUMIAN :		
SISTEM ELEKTRIKAL	:	2 Ohm
PERALATAN ELEKTRONIK	:	1 Ohm
PERALATAN LIFT	:	1 Ohm
PERALATAN DATA CENTER	:	0,5 Ohm
PROTEKSI PETIR	:	2 Ohm

OWNER/CLIENT
sawit
APPROVED : .../.../'...
..... (name)
..... (position)
(signed) ..... (Dep./Div.)

PROJECT
BPDP
KELAPA SAWIT
JL.Medan Merdeka Tim, RT.7/RW.1, Gambir, Kec. Gambir, Kota Jakarta Pusat, Daerah Khusus Ibukota Jakarta 10110

INTERIOR DESIGN CONSULTANT
PT. IMADEA AGKASAMA
Jl. Hati Suci No. 4 Gd. Sakura Lt. 2 Room 201
Kel. Kampung Bali, Kec. Tanah Abang, Jakarta Pusat
Telp. 021 - 2303483 , Fax. 021 - 2303483
APPROVED : //

MEP CONSULTANT
PT. DUTA PRATAMA ENGINEERING
MECHANICAL & ELECTRICAL ENGINEER
Rukan Taman Meruya Blok M No. 37, Jl. Botu Mulia No. 1
Meruya Utara Kembangan – Jakarta Barat 11620
Phone : 021-5845546, 5845547, 5845556, Fax : 021-58474531
Email : dpepl.me@gmail.com, pt.dpa.me@yahoo.com

DRAWING TITLE
DIAGRAM SATU GARIS
SISTEM PEMBUMIAN
SCALE : NTS
ALL MEASUREMENT MUST BE CHECKED AT BY SITE BY THE CONTRACTORS AND ANY DIFFERENCES REPORTED/INITIATED TO THE DESIGNER FOR CLARIFICATION BEFORE PROCEEDING.

#	REVISION :	DATE
1		.../.../'...
2		.../.../'...
3		.../.../'...
4		.../.../'...
5		.../.../'...

DRAWN : Sangaji, DATE : 15/05/24
CHECKED : Jefri, DATE : 15/05/24
DRAWING NUMBER : EL-102
PAGE
DRAWING FOR : TENDER
DATE : 2024/05/10