

NOTE :
— INSTALASI PEMADAM LIHAT JUGA GAMBAR
DIAGRAM SISTEM

KETERANGAN :


a (HURUF) – NAMA PIPA TEGAK
b (ANGKA) – NOMOR PIPA TEGAK
c – NOMINAL DIAMETER

- IHB = INDOOR HIDRAN BOX
PFE = PORTABLE FIRE EXTINGUISHER
CAP, 5 KG, CO2
PFE = PORTABLE FIRE EXTINGUISHER
CAP, 3 KG, DRY POWDER TYPE
TFE = TROLI FIRE EXTINGUISHER
CAP, 25 KG, CO2
X = KEPALA SPRINKLER (PENDENT TYPE)
BCV = BRANCH CONTROL VALVE
MCV = MAIN CONTROL VALVE
TDV = TEST DRAIN VALVE
SP = PIPA SPRINKLER
SPDR = PIPA TEGAK DRAIN SPRINKLER

PIPE SCHEDULES

No.	ND (mm)	QUANTITY (PCS)
1	25	2 SPRINKLER
2	32	3 SPRINKLER
3	40	5 SPRINKLER
4	50	10 SPRINKLER
5	65	20 SPRINKLER
6	80	40 SPRINKLER
7	100	100 SPRINKLER

SPR	Ø150	SPDR	Ø80
FH	Ø150		

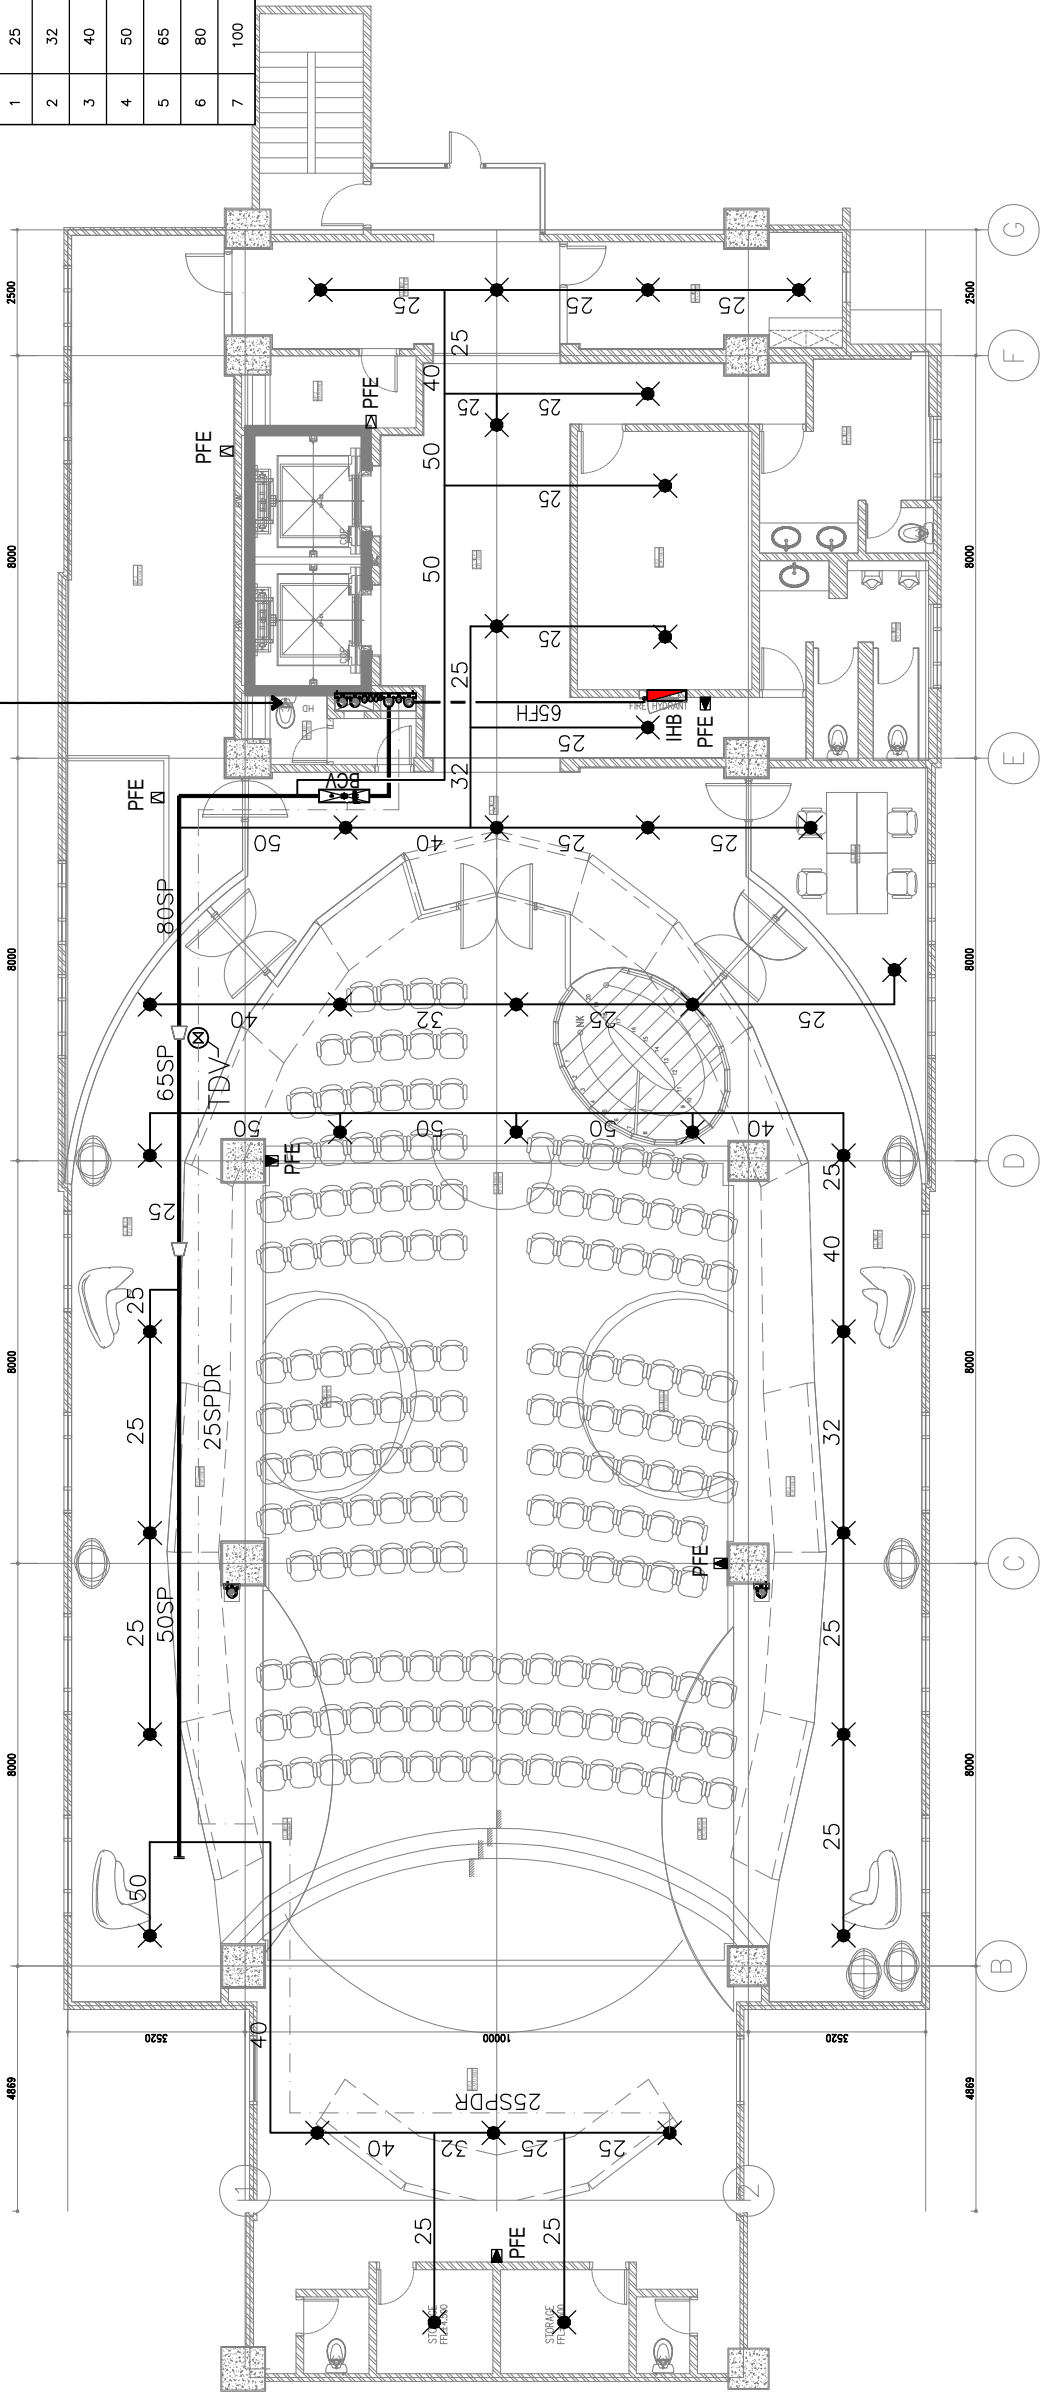

OWNER/CLIENT

BPDP
KELAPA SAWIT

JL. Medan Merdeka Tim, RT.17/RW.1, Gambir,
Kec. Gambir, Kota Jakarta Pusat, Daerah
Khusus Ibukota Jakarta 10110

APPROVED : .../.../...

(signed)

..... (name)
..... (position)
..... (Dep./Div.)

INTERIOR DESIGN CONSULTANT

PT. **M** ADEA AGKASAMA

Jl. Heli Suci No. 4 Gd. Sakura Lt. 2 Room 201
Kel. Kampung Bali, Kec. Tanah Abang, Jakarta Pusat
Telp. 021 - 2303483 , Fax. 021 - 2303483
APPROVED : //

MEP CONSULTANT

pt PT. DUTA PRATAMA ENGINEERING

MECHANICAL & ELECTRICAL ENGINEER

Ruang Tembok Merpati Blok A Jln. No. 25, A. Baru Muli No. 1
Kec. Kuning, Kota Jakarta Barat 10250
Phone 021-5667466, 5667467, 5667468, 5667469, 5667470
Email : dputa-mep@gmail.com, dputa-mep@ptduta.com

DRAWING TITLE

DENAH INSTALASI
PEMADAM KEBAKARAN LANTAI - 1

SCALE : 1 : 150

ALL MEASUREMENT MUST BE CHECKED AT BY SITE
BY THE CONTRACTORS AND ANY DIFFERENCES
REPORTED/INITIATED TO THE DESIGNER FOR
CONFIRMATION BEFORE PROCEEDING.

DRAWING NUMBER

PK-202

DRAWN

Maman

DATE : 15/05/24

CHECKED

Sopyan

DATE : 15/05/24

DRAWING FOR

TENDER

DATE : 2024/05/10

REVISION : R-1

#

DATE